

Митева, Емилия Г.

From: Богоева, Юлия К.
Sent: 25 октомври 2021 г. 15:45
To: Митева, Емилия Г.
Сс: Александров, Пламен Г.; Лазарова, Милена Т.
Subject: FW: ИНДИКАТИВНО ПРЕДЛОЖЕНИ ПО ПАЗАРНА КОНСУЛТАЦИЯ № 47834
Attachments: 2388.pdf; ds_sp6211_en_co.pdf; 19AR-03389-20201120-CE-DoC_14439199_01.pdf

АЕЦ Вх. № Ф-5835 / 25.10.2021 г.

From: Йосиф Делийски [<mailto:yosif.deliyski@abv.bg>]
Sent: Monday, October 25, 2021 3:20 PM
To: commercial
Subject: ИНДИКАТИВНО ПРЕДЛОЖЕНИ ПО ПАЗАРНА КОНСУЛТАЦИЯ № 47834

Йосиф Делийски

"ВАНТ ИНЖЕНЕРИНГ" ООД
1715, София
бул. Александър Малинов 89, етаж 8
тел.: +359 2 9024656
моб.: +359 879 197642



КВАНТ ИНЖЕНЕРИНГ ООД

София 1715
бул. Александър Малинов 89, ет. 8
тел.: + 359 2 868 88 60
факс: + 359 2 868 88 61
www.qvant-bg.com



изх. № КИ-2388/25.10.2021 год.

ДО „АЕЦ КОЗЛОДУЙ“ ЕАД

ИНДИКАТИВНО ПРЕДЛОЖЕНИ ПО ПАЗАРНА КОНСУЛТАЦИЯ № 47834

с предмет: „Доставка на SF6 (елегаз) анализатор“

Уважаеми госпожи/господа,

Във връзка с провеждане на горесцитираната пазарна консултация, предоставяме на Вашето внимание следното предложение:

I. Ценови параметри:

№	Наименование	К-во	М.ед.	Ед. цена	Обща цена
1.	Газ анализатор за SF6(елегаз) Wika GA11	1	бр.	54 500,00	54 500,00

Словом: Петдесет и четири хиляди и петстотин лева без ДДС

II. Срок за изпълнение:

1. Срок за доставка на оборудването – 3/три/ месеца.
2. Място на доставка – DDP Козлодуй.
3. Гаранционен срок – 24 месеца от датата на доставка. Време за реакция при възникнал дефект – 7 дни. Време за отстраняване на дефект – 60 календарни дни.
4. Производител – Wika, ЕС.
5. Съпроводителна документация:
 - Декларация за съответствие;
 - Декларация за произход;
 - Инструкция за експлоатация.

III. Адрес за кореспонденция и лице за контакти:

„Квант инженеринг“ ООД, 1715 гр. София, бул. Александър Малинов 89,
етаж 8; тел.: 02/868 8860, факс: 02/868 8861, e-mail: office@qvant-bg.com

Лице за контакти – Йосиф Делийски – управител, моб.: 0879197642,
e-mail: yosif.deliyski@abv.bg

25.10.2021г.

С ува

заличено по
ЗЗЛД

/Йосиф Делийски – управител/



EU-Konformitätserklärung EU Declaration of Conformity

Dokument Nr.
Document No. 14439199.01

Wir erklären in alleiniger Verantwortung, dass die mit CE gekennzeichneten Produkte
We declare under our sole responsibility that the CE marked products

Typenbezeichnung
Type Designation GA11

Beschreibung
Description Analysegerät zur Ermittlung der Gasqualität
von Isoliergasen
*Analytic instrument for determining the quality of
insulation gases*

gemäß gültigem Datenblatt
according to the valid data sheet SP 62.11

mit den nachfolgenden relevanten Harmonisierungsvorschriften der Union
übereinstimmen
are in conformity with the following relevant Union harmonisation legislation

Angewandte harmonisierte Normen
Applied harmonised standards

2011/65/EU	Gefährliche Stoffe (RoHS) <i>Hazardous substances (RoHS)</i>	EN IEC 63000:2018
2014/35/EU	Niederspannungsrichtlinie (NSR) <i>Low voltage directive (LVD)</i>	EN 61010-1:2010
2014/30/EU	Elektromagnetische Verträglichkeit (EMV) <i>Electromagnetic Compatibility (EMC)</i>	EN 61326-1:2013

Unterzeichnet für und im Namen von / *Signed for and on behalf of*

WIKA Alexander Wiegand SE & Co. KG

Klingenberg, 2020-11-20

заличено по 33ЛД

Thomas Heckler, Vice President
Industrial Instrumentation – WES WEGrid Solutions

Joachim Ackermann, Director Quality Management
Industrial Instrumentation – WES WEGrid Solutions

WIKA Alexander Wiegand SE & Co. KG
Alexander-Wiegand-Straße 30
63911 Klingenberg
Germany
WEEE-Reg.-Nr. DE 92770372

Tel. +49 9372 132-0
Fax +49 9372 132-406
E-Mail info@wika.de
www.wika.de

Kommanditgesellschaft: Sitz Klingenberg –
Amtsgericht Aschaffenburg HRA 1819

Komplementärin:
WIKA International SE - Sitz Klingenberg -
Amtsgericht Aschaffenburg HRB 10505
Vorstand: Alexander Wiegand
Vorsitzender des Aufsichtsrats: Dr. Max Egli
19AR-03389

Analytic instrument for SF₆ gas, g³ gas or N₂ gas Model GA11


WIKA data sheet SP 62.11

Applications

- Analysis of the gas quality in gas-filled equipment
- For the analysis of SF₆ gas, g³ gas or N₂ gas

Special features

- Provides measured values for humidity, gas composition (purity) and decomposition products (optional)
- Three methods for emission-free treatment of the measurement gas:
 - Direct back pumping into the tested gas compartment
 - Pumping into an external gas cylinder
 - Collecting in the external gas bag
- Battery power for min. 5 measurements or mains supply
- Not compromised by transport restrictions (IATA)

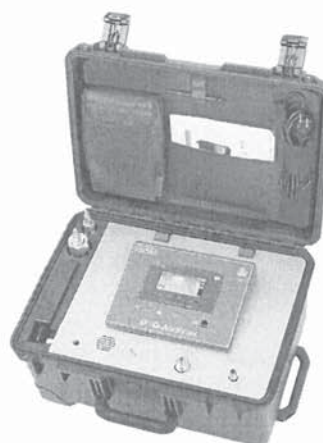

Analytic instrument model GA11

Description

The model GA11 analytic instruments are innovative and reliable instruments for determining the quality of different insulating gases. Among these insulating gases are included SF₆, Novec™ 4710 gas mixture (g³ gas) as well as applications for technical air (clean air/ dry air, based on oxygen and nitrogen). The model GA11 can measure the concentration of up to six parameters, depending on the selected equipment variant.

Set up

A clearly arranged menu structure and a 7" colour touchscreen allow for intuitive operation. Sensors for the measurement of purity and humidity are included as standard. Optionally, the model GA11 can be extended with electrochemical sensors for determining the SF₆ gas decomposition products.

The measured gases can either be pumped back into the gas compartment of the switchgear or an external gas cylinder or, alternatively, it can be collected directly in a gas bag. In each case, emission into the atmosphere is avoided. The described treatment of the measuring gas can also be carried out in the battery mode if mains voltage is not available.

Field use

The analytic instrument is protected from the harsh environmental conditions through an impact-resistant and waterproof plastic case. The hard-top case, which is designed for field use, is fitted with wheels and a telescopic carrying handle for ease of transport.


Operator interface

Operation

The user interface is intuitive and can be operated via the touchscreen.

English, German, Spanish, Japanese, Chinese and Korean are the available languages for selection.

After connecting the gas compartment or the gas cylinder under test, the measurement can be started.

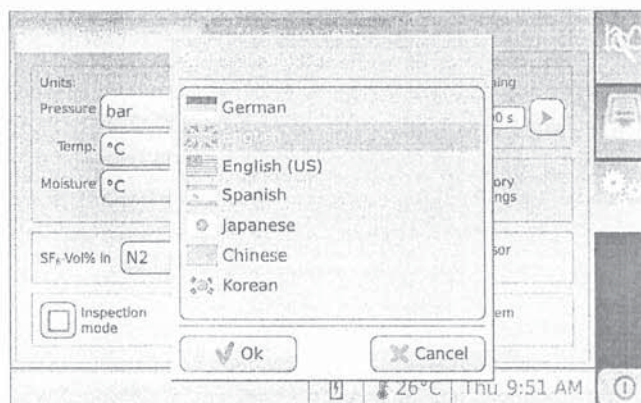


Language selection

Displaying the measurement results

The measurement results on the concentration of purity, decomposition products and humidity of SF₆ gas are displayed after the end of the measurement.

These results are automatically compared to the set guidelines for contaminated or reusable SF₆ gas (CIGRE B3.02.01, IEC or in accordance with user-defined specifications). Accordingly, an OK or Not-OK symbol is shown.

The GA11 makes it quick and easy to import a measuring point list, edited on a PC. Due to the complexity of the measurement task, specific knowledge is a pre-requisite, see IEC 62271-4:2013, ASTM D2029-97:2017 and CIGRÉ - SF₆ Measurement guide (723).

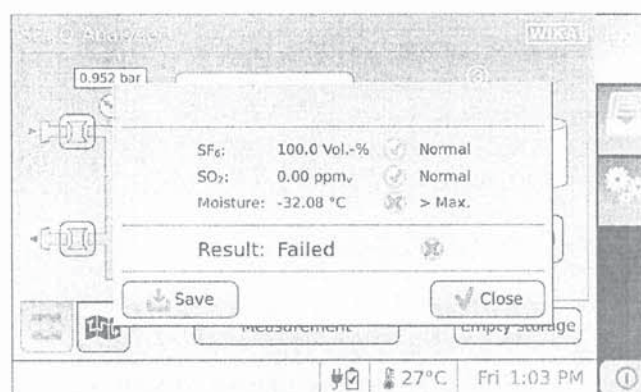

Measured value display

Saving and export of the values

Up to five hundred measurement results can be stored within the instrument and can be transferred via the USB interface.


The enclosed software "SF₆-Q-Analyser measurement viewer" is free of charge and can output the measurement results as a PDF report or in CSV format.

The CSV format is suitable for importing the data using Microsoft® Excel® or other table calculation programs or database programs.



Database

Instrument construction

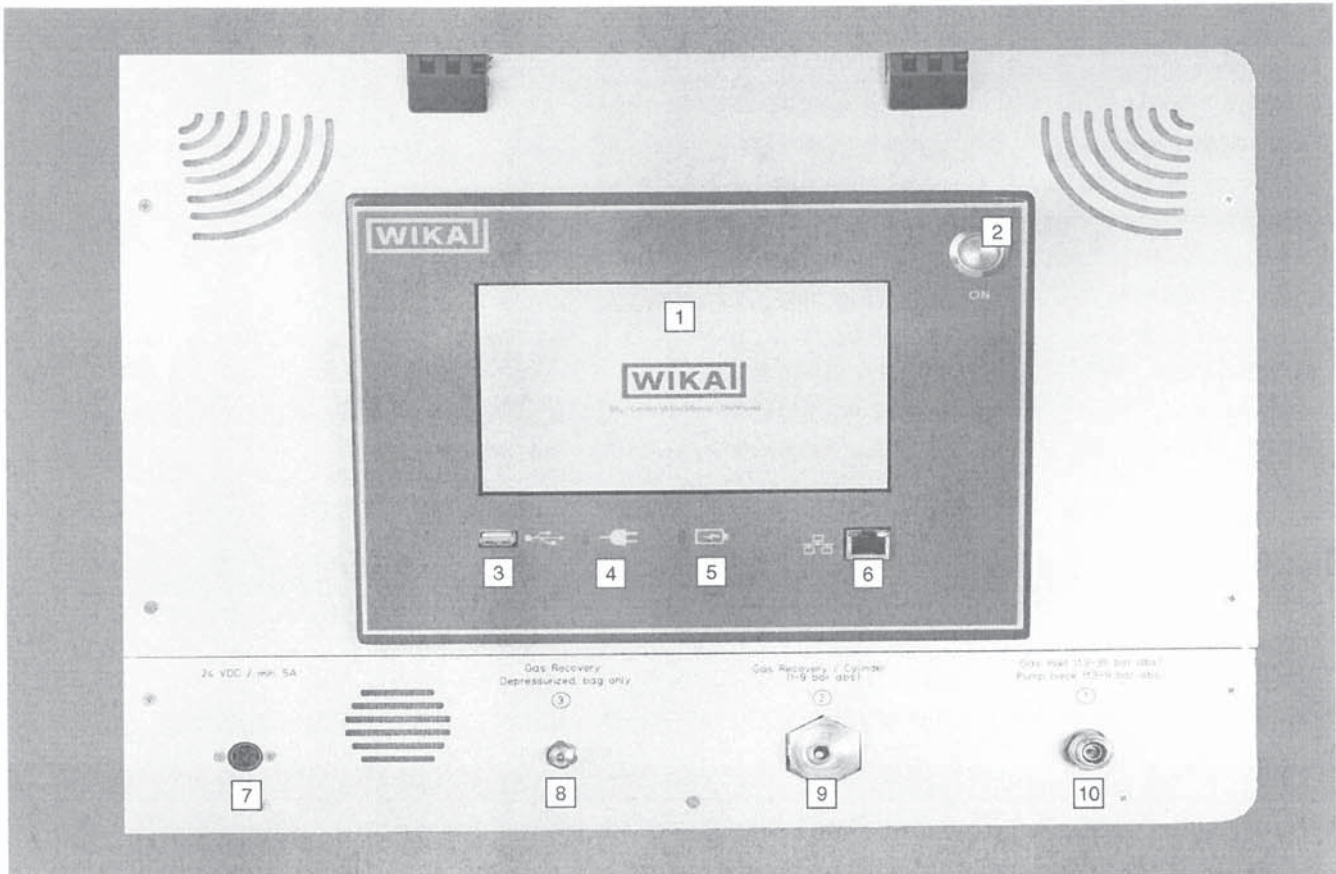

- 1 TFT touchscreen
- 2 On and Off button
- 3 USB interface
- 4 Mains supply indicator
- 5 Charging indicator
- 6 Network connection (LAN)
- 7 Power connection
- 8 Outlet for gas recovery bag
- 9 Outlet for gas cylinder
- 10 Inlet, return pumps

Specifications, version for SF₆ gas

Base instrument	
Connections	
Inlet/return pumps	Quick coupling with self-sealing valve
Outlet for gas cylinder	Self-sealing valve DN 8
Outlet for gas recovery bag	Quick coupling, self-sealing valve
Permissible pressure ranges	
Inlet/return pumps	1.3 ... 35 bar abs./1.3 ... 10 bar abs.
Outlet for gas cylinder	1.3 ... 10 bar abs.
Outlet for gas recovery bag	< 1.015 bar abs.
TFT touchscreen	7" (resolution 800 x 480)
Voltage supply	
Battery power	Lithium-ion battery, battery is charged during mains supply mode
Mains operated	AC 90 ... 264 V (50 ... 60 Hz)
Permissible temperature ranges	
Operation	0 ... 40 °C
Storage	-20 ... +60 °C
Flow measuring gas	20 litres/hour
Dimensions	W x H x D: 538 x 406 x 297 mm
Weight	approx. 25 kg
Humidity sensor	
Measurement principle	Polymer-based capacitive humidity sensor
Measuring range/accuracy	-40 ... +20 °C dew point ±2 °C dew point -60 ... < -40 °C dew point ±4 °C dew point
Resolution	1 °C
Units	°Ctd/°Ftd/ppm _w /ppm _v /°Ctdpr/°Ftdpr (Dew point at gas compartment pressure, relative to ambient pressure and temperature-compensated at 20 °C)
Calibration interval	2 years
SF ₆ percentage sensor	
Measurement principle	Sound velocity
Measuring range/accuracy	0 ... 100 % ±0.5 % based on SF ₆ /N ₂ mixtures (calibration for SF ₆ /CF ₄ mixtures on request)
Resolution	0.1 %
Optional sensor technology	
SO ₂ sensor	
Measurement principle	Electrochemical SO ₂ sensor
Measuring range/accuracy	In combination with HF sensor, only 0 ... 10 or 0 ... 20 ppm _v make sense. 0 ... 10 ppm_v ±0.5 ppm_v 0 ... 20 ppm_v ±1 ppm_v 0 ... 100 ppm_v ±3 ppm_v 0 ... 500 ppm_v ±5 ppm_v
Resolution	0.1 ppm _v
Permissible air humidity	15 ... 90 % r. h. (non-condensing)
Max. zero offset	0.1 ppm _v
Long-term stability	< 1 % signal degradation/month (linear) < 0.5 % at 0 ... 500 ppm _v
Service life	2 years starting from installation

HF sensor

Measurement principle	Electrochemical hydrogen fluoride sensor
Measuring range/accuracy	0 ... 10 ppm _v ±1 ppm _v
Resolution	0.1 ppm _v
Permissible air humidity	15 ... 90 % r. h. (non-condensing)
Max. zero offset	0.1 ppm _v
Long-term stability	< 1 % signal degradation/month (linear)
Service life	2 years starting from installation

H₂S sensor

Measurement principle	Electrochemical H ₂ S sensor
Measuring range/accuracy	0 ... 100 ppm _v ±5 ppm _v
Resolution	0.1 ppm _v
Permissible air humidity	15 ... 90 % r. h. (non-condensing)
Max. zero offset	0.1 ppm _v
Long-term stability	< 1 % signal degradation/month (linear)
Service life	2 years starting from installation

CO sensor

Measurement principle	Electrochemical CO sensor
Measuring range/accuracy	0 ... 500 ppm _v ±9 ppm _v
Resolution	0.1 ppm _v
Permissible air humidity	15 ... 90 % r. h. (non-condensing)
Max. zero offset	0.1 ppm _v
Long-term stability	< 1 % signal degradation/month (linear)
Service life	2 years starting from installation

Precision pressure sensor

Measuring range	0 ... 10 bar abs.
Accuracy	≤ ±0.05 % of span Including non-linearity, hysteresis, non-repeatability, zero offset and end value deviation (corresponds to measured error per IEC 61298-2). Calibrated in vertical mounting position with process connection facing downwards.
Non-linearity (per IEC 61298-2)	≤ ±0.04 % of span BFSL
Temperature error	0 ... 10 °C: ≤ ±0.2 % of span/10 K 10... 40 °C: no additional temperature error
Long-term stability	≤ ±0.1 % of span/year
Measuring rate	2 ms
Calibration interval	2 years

Specifications, version for g³ gas (3M™ Novec™ 4710)

Base instrument

Connections

Inlet/return pumps	Quick coupling with self-sealing valve
Outlet for gas cylinder	Self-sealing valve DN 8
Outlet for gas recovery bag	Quick coupling, self-sealing valve

Permissible pressure ranges

Inlet/return pumps	1.3 ... 12 bar abs.
Outlet for gas cylinder	1.3 ... 12 bar abs.
Outlet for gas recovery bag	< 1.015 bar abs.

TFT touchscreen	7" (resolution 800 x 480)
-----------------	---------------------------

Voltage supply

Battery power	Lithium-ion battery, battery is charged during mains supply mode
Mains operated	AC 90 ... 264 V (50 ... 60 Hz)

Permissible temperature ranges

Operation	0 ... 40 °C
Storage	-20 ... +60 °C

Flow measuring gas	20 litres/hour
--------------------	----------------

Dimensions	W x H x D: 538 x 406 x 297 mm
------------	-------------------------------

Weight	approx. 25 kg
--------	---------------

Humidity sensor

Measurement principle	Polymer-based capacitive humidity sensor
-----------------------	--

Measuring range/accuracy	■ -25 ... 0 °C dew point ±2 °C dew point ■ -35 ... -25 °C dew point ±3 °C dew point ■ -55 ... -35 °C dew point ±4 °C dew point
--------------------------	--

Resolution	1 °C
------------	------

Units	°Ctd/°Ftd/ppm _w /ppm _v /°Ctdpr/°Ftdpr (Dew point at gas compartment pressure, relative to ambient pressure and temperature-compensated at 20 °C)
-------	---

Calibration interval	2 years
----------------------	---------

g³ percentage sensor (3M™ Novec™ 4710 gas)

Measurement principle	Sound velocity
-----------------------	----------------

Measuring range/accuracy	0 ... 10 % (percentage Novec™ 4710) ±0.3 % based on Novec™ 4710/CO ₂ mixture ¹⁾ Any measuring range on request, based on Novec™ 4710/CO ₂ or Novec™ 4710/N ₂ mixtures ²⁾
--------------------------	--

1) ±0.5 % if the ambient pressure (standard at 1,000 mbar abs.) deviates by more than 100 mbar.

2) For special calibrations, the measuring tolerances may deviate from the standard specification.

Optional sensor technology

Oxygen sensor

Measurement principle	Optical
Measuring range/accuracy	0 ... 10 % vol. ±0.3 % vol. (option: 0 ... 25 % vol.) ³⁾
Permissible air humidity	15 ... 90 % r. h. (non-condensing)
Max. zero offset	0.2 % vol.
Long-term stability	< 2 % signal degradation/month (linear)
Service life	2 years starting from installation

3) ±0.5 % at 0 ... 25 %, for special calibrations the measuring tolerances may deviate from the standard specification.

Specifications, version for N₂ gas

Base instrument	
Connections	
Inlet/return pumps	Quick coupling with self-sealing valve
Outlet for gas cylinder	Self-sealing valve DN 8
Outlet for gas recovery bag	Quick coupling, self-sealing valve
Permissible pressure ranges	
Inlet/return pumps	1.3 ... 12 bar abs. / 1.3 ... 10 bar abs.
Outlet for gas cylinder	1.3 ... 10 bar abs.
Outlet for gas recovery bag	< 1.015 bar abs.
TFT touchscreen	7" (resolution 800 x 480)
Voltage supply	
Battery power	Lithium-ion battery, battery is charged during mains supply mode
Mains operated	AC 90 ... 264 V (50 ... 60 Hz)
Permissible temperature ranges	
Operation	0 ... 40 °C
Storage	-20 ... +60 °C
Flow measuring gas	40 litres/hour
Dimensions	W x H x D: 538 x 406 x 297 mm
Weight	approx. 25 kg

Humidity sensor	
Measurement principle	Polymer-based capacitive humidity sensor
Measuring range/accuracy	■ -25 ... 0 °C dew point ±2 °C dew point ■ -35 ... -25 °C dew point ±3 °C dew point ■ -55 ... -35 °C dew point ±4 °C dew point
Resolution	1 °C
Units	°Ctd/°Ftd/ppm _w /ppm _v /°Ctdpr/°Ftdpr (Dew point at gas compartment pressure, relative to ambient pressure and temperature-compensated at 20 °C)
Calibration interval	2 years

N ₂ percentage sensor (helium in N ₂)	
Measurement principle	Sound velocity
Measuring range/accuracy	0 ... 5 % vol. ±0.5 % vol. Any measuring range on request, based on helium in N ₂ mixtures ¹⁾

1) For special calibrations, the measuring tolerances may deviate from the standard specification.

N ₂ percentage sensor (SF ₆ in N ₂)	
Measurement principle	Sound velocity
Measuring range/accuracy	0 ... 100 % vol. ±0.5 % vol.

Optional sensor technology

Oxygen sensor	
Measurement principle	Optical
Measuring range/accuracy	0 ... 10 % vol. ±0.3 % vol. (option: 0 ... 25 % vol. ±0.3 % vol.) ¹⁾
Permissible air humidity	15 ... 90 % r. h. (non-condensing)
Max. zero offset	0.2 % vol.
Long-term stability	< 2 % signal degradation/month (linear)
Service life	2 years starting from installation

1) ±0.5 % at 0 ... 25 %, for special calibrations the measuring tolerances may deviate from the standard specification.

Accessories

	Description	Order number
	Gas recovery bag, model GA45 - Low weight and easily transportable - Cost-effective version to prevent SF₆ gas emissions - Compatible with all WIKA gas analytic instruments - With overpressure valve as burst protection - Resistant to decomposition products - Storage capacity 110 litres For further specifications see data sheet SP 62.08	14013015
	Hose connection 4 m, Ø 2.5 mm	14200598

Ordering information

Model / Version / Optional sensor technology / Accessories

© 03/2013 WIKA Alexander Wiegand SE & Co. KG, all rights reserved.
 The specifications given in this document represent the state of engineering at the time of publishing.
 We reserve the right to make modifications to the specifications and materials.

WIKA data sheet SP 62.11 · 10/2019

Page 8 of 8



WIKAL Alexander Wiegand SE & Co. KG
 Alexander-Wiegand-Straße 30
 63911 Klingenberg/Germany
 Tel. +49 9372 132-0
 Fax +49 9372 132-406
 info@wika.de
 www.wika.de